



INSTALLATION INSTRUCTIONS:


- 1- Use four 1/2" sheet metal screws on each flange, to screw the return air elbow onto the other side of the filter rack.
- 2- Use cleats to attach the duct on the top side of return air elbow. See cleat instructions for installation.

NOTE:

Used for residential applications. Industrial tape, foil, or sealer can be used.

WARNING!!

Improper installation may result in damage to product or inefficiencies in the system. Use proper PPE and equipment during cutting, bending, and installation processes. If local codes differ from these instructions follow local building codes.

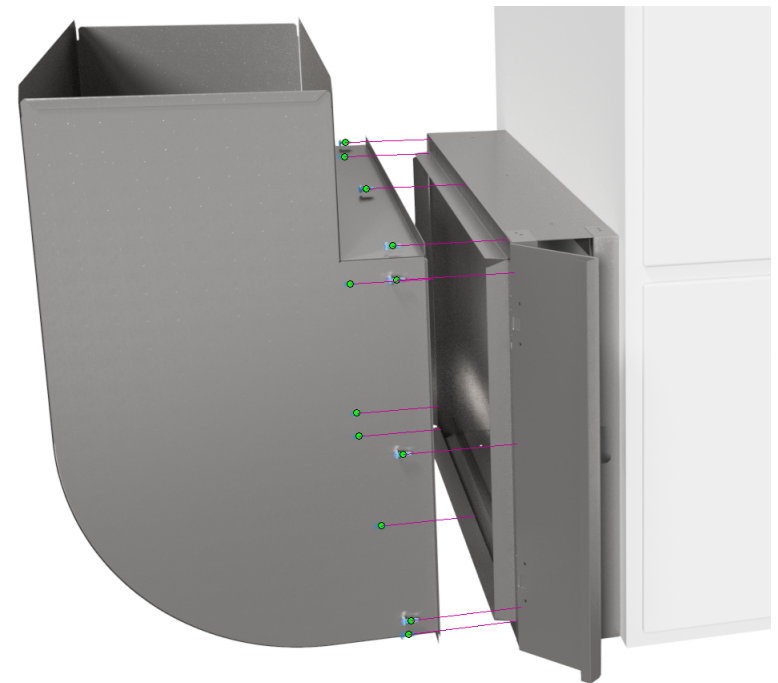

INSTALLATION VIEW



INSTALLED VIEW

[\(403\) 327-9871](tel:4033279871)

sales@tradesmanmfg.ca

www.tradesmanmfg.ca